


# Blount County Dept. of Building Safety

## **GAS METER INFORMATION**

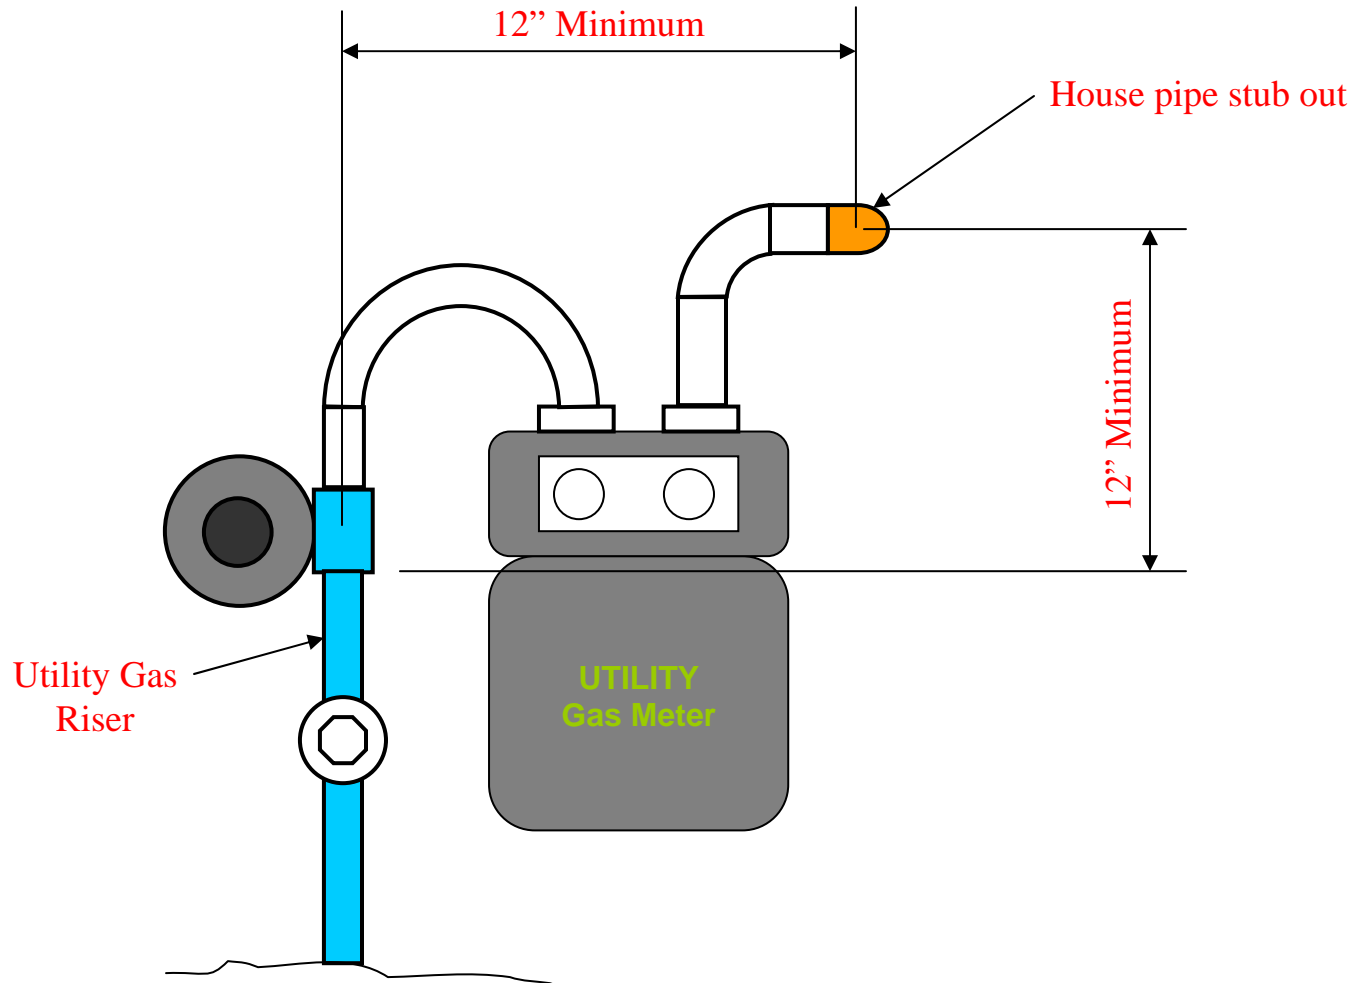

**1.** In the above illustration, the house side gas pipe stub out (from the house wall, colored orange above) must be a minimum of 12" above and 12" minimum to the right of the UTILITY riser pipe (shown in blue).